



# CITY OF TAMPA

Bob Buckhorn, Mayor

CONTRACT ADMINISTRATION DEPARTMENT

Michael W. Chucran, Director

## ADDENDUM 3

August 1, 2017

Contract 17-C-00021; Citywide Water Meter and Valve Installation

Bidders on the above referenced project are hereby notified that the following addendum is made to the Contract Documents. BIDS TO BE SUBMITTED SHALL CONFORM TO THIS NOTICE.

Item 1: Specifications – insert the attached detail 2.14C.

All other provisions of the Contract Documents and Specifications not in conflict with this Addendum shall remain in full force and effect. Questions are to be e-mailed to Contract Administration@tampagov.net.

*Jim Greiner*

Jim Greiner, P.E., Contract Management Supervisor

1/2" PVC Screened Standpipe


CHARLES INDUSTRIES LLPH MODEL 117  
(two-piece, split base and low profile dome)  
Charles Industries Part No. 117 SS07-2 0 000 BK

AS TALL AS POSSIBLE  
INSIDE PEDESTAL COVER

Approved Automatic  
Air Release/Air Vacuum Valve (AVAR)  
Install Off-Center in Pedestal (lengthwise)  
to provide easy access to Curb Stop Op Nut

Finish Grade

FORD 2" CURB STOP (FIPxFIP)  
LOCATE STOP NEAR GRAVEL,  
w/MINIMUM NIPPLE BETWEEN  
STOP & AVAR BODY. FACE  
OPERATOR NUT TO OPEN AREA  
(LENGTHWISE) IN BOX,  
FOR EASY ACCESS.

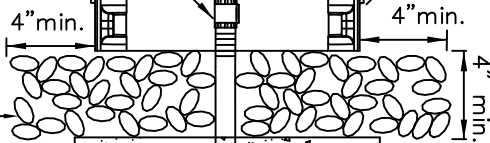

6"x2'x2'  
CONCRETE PAD  
W/ WIRE MESH (6 GA. 4"x4" W.W.F.)

Note: Pedestal is shown in  
Detail to illustrate assembly  
configuration only. Consult  
Charles Industries LLPH 117  
brochure for actual pedestal  
dimensions.

2" SCH. 40 BRASS PIPE  
OR 316 SS SCH 40

2" SCH. 40 BRASS PIPE  
OR SDR 9 HDPE TUBE  
OR 316 SS SCH 40

(2) STREET ELL  
TYPE "K" COPPER  
OR SCH 40 BRASS  
OR 316 SS SCH 40

(1) 2" STREET ELL  
(1) 2" ELL

2% MINIMUM SLOPE  
w/ 3' Min. Cover

2" Corp. Stop

2" TAP W/  
STAINLESS STEEL  
DOUBLE STRAP  
SERVICE SADDLE

Notes:

1. Air Release Valve to be installed inside of a Charles Ind. buried, square, split pedestal with low profile dome or approved equal.
2. Lock mechanism to be located min. 2" above finish grade.
3. Pedestal base to be placed on 4" thick, compacted gravel bed, on top of 6" thick 2'x2' concrete pad.
4. Obtain (2) Reflective WATER stickers from City and affix to pedestal.

TAMPA  
WATER  
DEPARTMENT

APPROVED  
Jan. 2016

REVISED  
RNM Rev. 3

AUTOMATIC AIR VACUUM/  
AIR RELEASE VALVE

2.14C